

Technical Information

Oasis - FSIB Refrigerated Self-Service Produce Case

Structural Concepts®

DELIVERING FRESH. ALWAYS.™

DIMENSIONS / SHIPPING

Model	L"	L1"	L2"	Est Wt (lbs)
FSIB4R	48.625	50.875	24.375	N/A
FSIB8R	95.875	98.125	37.500	N/A

ELECTRICAL

Model	System Circuit Volts			Ph	Frq	Rated Load Amps	Min Cir Amps	Max OCP Amps	Watts	Wires	NEMA Plug	Amps Lights	Amps Fans	Amps Anti-Sweats	Amps Misc/Refrig/Heat
FSIB4R	Remote (R404A)	Circuit #1	110-120	1	60	0.80	15	15	64	2+G	Leads Single		0.62	0.18	N/A
FSIB8R	Remote (R404A)	Circuit #1	110-120	1	60	1.60	15	15	128	2+G	Leads Single		1.24	0.36	N/A

REFRIGERATION

Model	Zone	Section	System	Envt	REMOTE REFRIGERATION					GLYCOL / R744 REFRIGERATION			
					SST (°F)	Conv. Rack BTUH	Para. Rack BTUH	Defrost Interval (Hrs)	Defrost Duration	Total GPM	Pressure Drop (psi)	Concent (%)	Liquid Temp (°F)
FSIB4R	All	Main	Remote-R404A	Type I	20	3,110	2,880	4.00	30.00	N/A	N/A	N/A	N/A
FSIB8R	All	Main	Remote-R404A	Type I	20	8,078	7,480	4.00	30.00	N/A	N/A	N/A	N/A

INTENDED ENVIRONMENT

Type I - Designed to operate in ambient conditions of 75°F with 55% relative humidity unless noted otherwise under Envt above.

WARMEST AVERAGE PRODUCT TEMP & INTENDED USE OF ZONES

Zone	Temp (°F)	Intended Use
1	40	Packaged / unpackaged refrigerated products

REGULATORY

All Models	Accordance with AHRI Std 1200 ETL Listed to UL 471 ETL Listed to CAN/CSA 22.2 No. 120 ETL Sanitation to NSF/ANSI 7
------------	---

IMPORTANT NOTES

- 1) ELECTRICAL NOTE: If GFCI is required, a GFCI breaker MUST be used in lieu of a GFCI receptacle.
- 2) 60" Minimum door entry clearance required (Without shipping skid) for Remote unit & 64" for Self-Contained.
- 3) Remote units are supplied with levelers which must be adjusted during installation to ensure the unit is level and plumb.







In Accordance with
AHRI Std 1200

Oasis - FSIB Refrigerated Self-Service Produce Case

Structural Concepts®

DELIVERING FRESH. ALWAYS.™

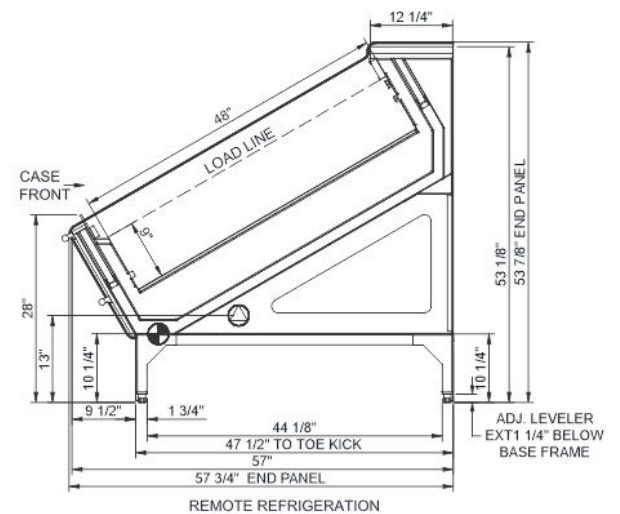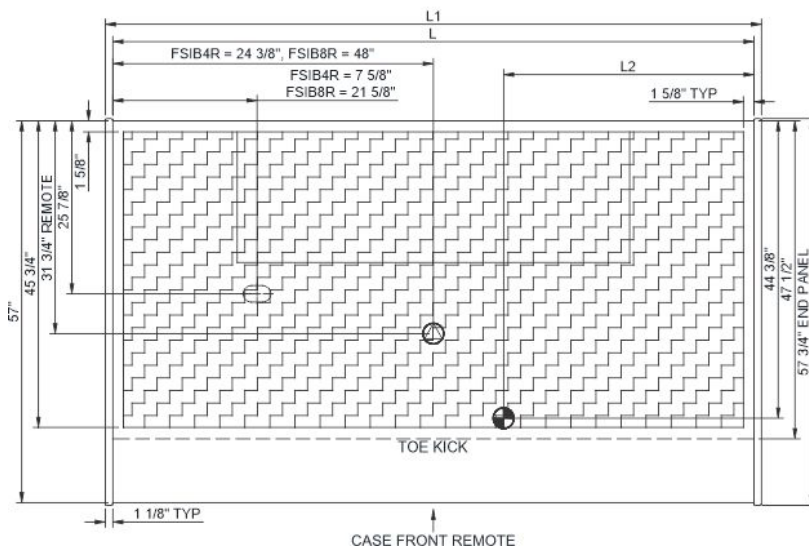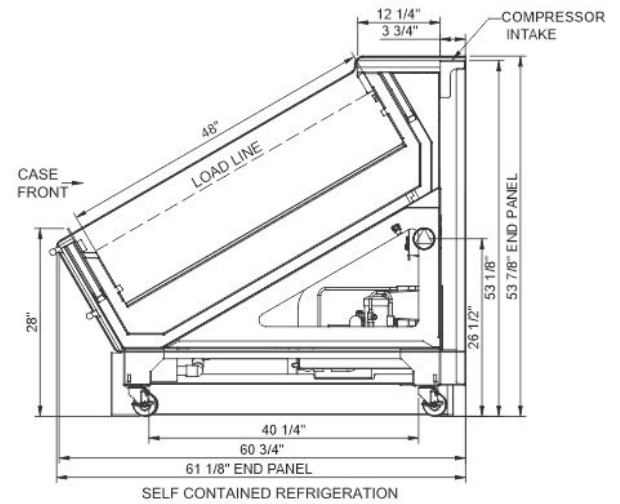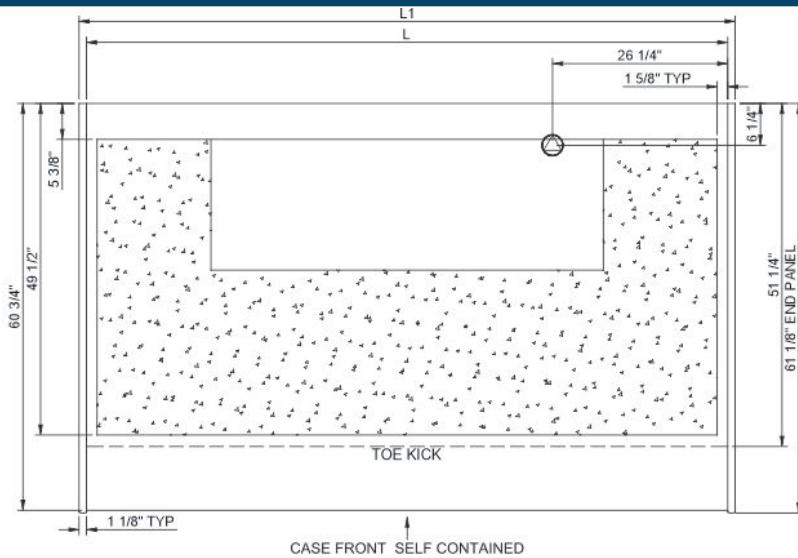

NOTE: ALL DIMENSIONS APPROXIMATE

