

Technical Information

Grocerant - Heated Service Food Bar 43"D

Structural Concepts®

DELIVERING FRESH. ALWAYS.™

DIMENSIONS / SHIPPING

Model	L"	L1"	L2"	Est Wt (lbs)
FB3S-2H	N/A	36.000	12.625	N/A
FB5S-4H	N/A	64.000	12.625	N/A
FB10S-8H	N/A	122.000	12.625	N/A

ELECTRICAL

Model	System Circuit Volts			Ph	Frq	Rated Load Amps	Min Cir Amps	Max OCP Amps	Watts	Wires	NEMA Plug	Amps Lights	Amps Fans	Amps Anti-Sweats	Amps Misc/Refrig/Heat
FB3S-2H	Heat (N/A)-Type I Env	Circuit #1	208	1	60	11.59	15	15	2,410	2+G	Leads Multiple	N/A	N/A	11.59	N/A
	Heat (N/A)-Type I Env	Circuit #1	208	1	60	4.27	15	15	888	2+G	Leads Multiple	N/A	N/A	4.27	N/A
FB5S-4H	Heat (N/A)-Type I Env	Circuit #1	208	1	60	23.06	30	30	4,797	2+G	Leads Multiple	N/A	N/A	23.06	N/A
	Heat (N/A)-Type I Env	Circuit #1	208	1	60	8.70	15	15	1,810	2+G	Leads Multiple	N/A	N/A	8.70	N/A
FB10S-8H	Heat (N/A)-Type I Env	Circuit #1	208	1	60	23.06	30	30	4,797	2+G	Leads Multiple	N/A	N/A	23.06	N/A
	Heat (N/A)-Type I Env	Circuit #2	208	1	60	23.06	30	30	4,797	2+G	Leads Multiple	N/A	N/A	23.06	N/A
	Heat (N/A)-Type I Env	Circuit #1	208	1	60	8.70	15	15	1,810	2+G	Leads Multiple	N/A	N/A	8.70	N/A
	Heat (N/A)-Type I Env	Circuit #2	208	1	60	8.70	15	15	1,810	2+G	Leads Multiple	N/A	N/A	8.70	N/A

REFRIGERATION

Model	Zone	Section	System	Envt	REMOTE REFRIGERATION					GLYCOL / R744 REFRIGERATION			
					SST (°F)	Conv. Rack BTUH	Para. Rack BTUH	Defrost Interval (Hrs)	Defrost Duration	Total GPM	Pressure Drop (psi)	Concent (%)	Liquid Temp (°F)

INTENDED ENVIRONMENT

Type I - Designed to operate in ambient conditions of 75°F with 55% relative humidity unless noted otherwise under Envt above.

WARMEST AVERAGE PRODUCT TEMP & INTENDED USE OF ZONES

Zone	Temp (°F)	Intended Use
1	160	Unpackaged heated product

IMPORTANT NOTES

- 1) ELECTRICAL NOTE: If GFCI is required, a GFCI breaker MUST be used in lieu of a GFCI receptacle.
- 2) Units must be shimmed during installation to ensure the unit is level and plumb.
- 3) Floor drain required for steam wells.
- 4) Auto fill options use 1/2" water line.
- 5) Manual fill and Auto fill options use 3/4" drain line.

REGULATORY

All Models	ETL Listed to UL 197 ETL Listed to CAN/CSA 22.2 No. 109 ETL Sanitation to NSF/ANSI 4
------------	--






Grocerant - Heated Service Food Bar 43"D


Structural Concepts®


DELIVERING FRESH. ALWAYS.™

	WELLS
FB3S-2H	2
FB5S-4H	4
FB10S-8H	8

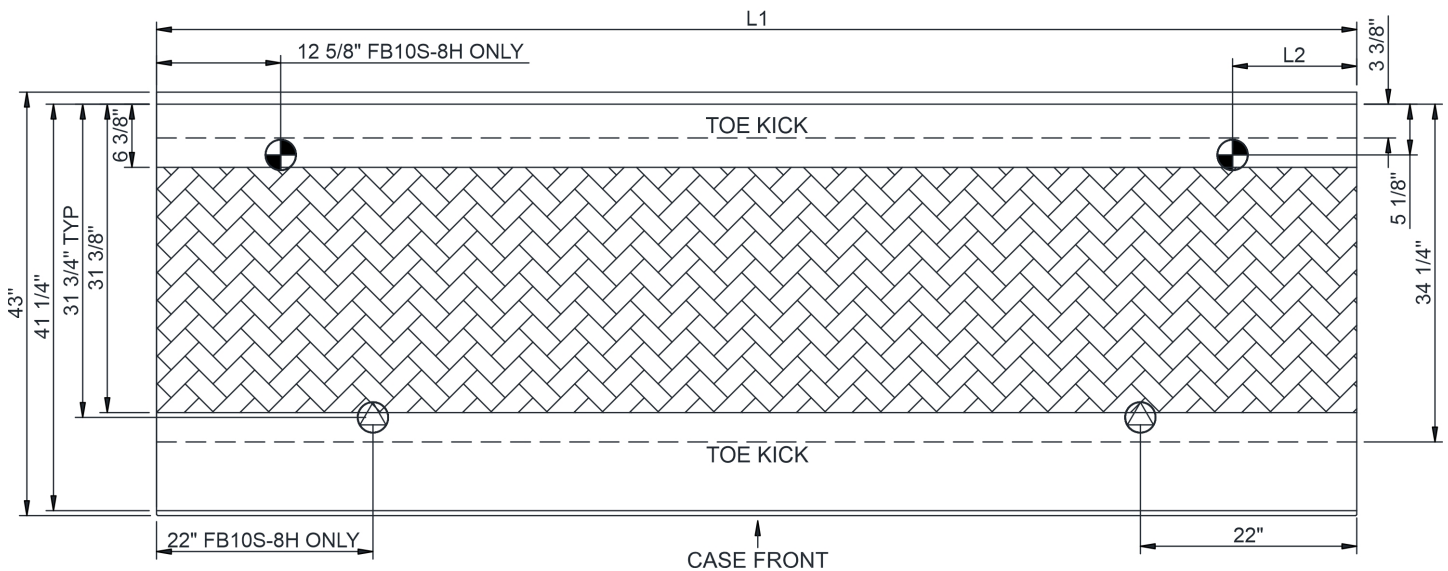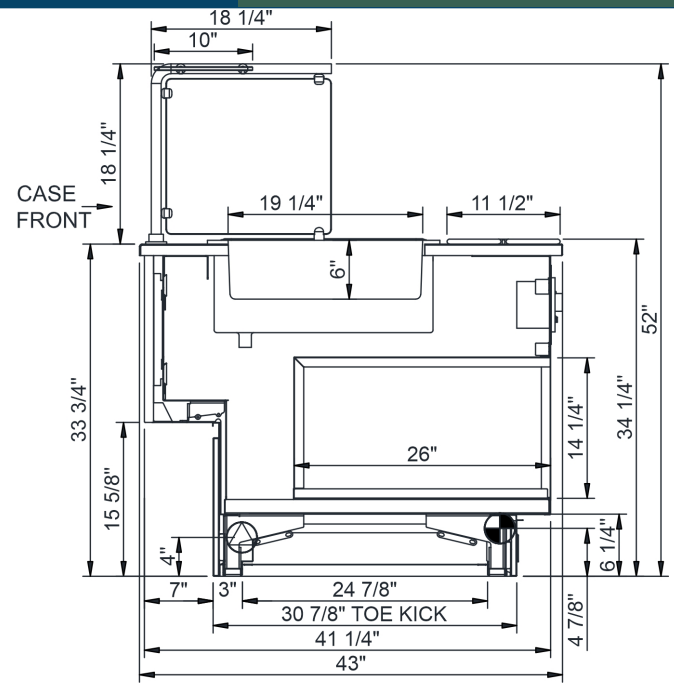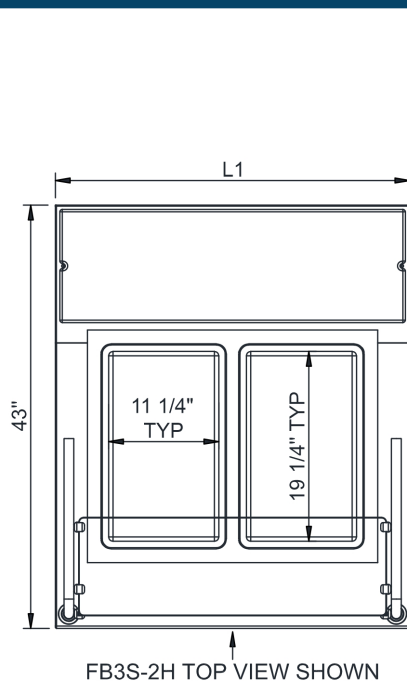

NOTE: ALL DIMENSIONS APPROXIMATE

 **ELECTRICAL JUNCTION BOX**
(SUPPLIED WITH 6" LEADS OR POWER CORD).

 **LOCATION OF DRAIN TUBE FOR REMOTE REF.**
ONLY (SUPPLIED WITH $\frac{3}{4}$ " OR $1\frac{1}{2}$ " PVC TUBE).

 REFRIGERATION LINE CONNECTION.

 REMOTE FLOOR SINK & UTILITIES ACCESS AREA.

 SELF-CONTAINED CASE SERVICE ACCESS AREA.

 DRY CASE SERVICE ACCESS AREA.