

# Technical Information

Oasis - Refrigerated Self-Service Case 26"D

Structural Concepts®

DELIVERING FRESH. ALWAYS.™

## DIMENSIONS / SHIPPING

Model	L"	L1"	L2"	Est Wt (lbs)
BN37R	33.125	35.625	0.000	N/A
BN47R	45.125	47.625	0.000	N/A
BN57R	57.125	59.625	0.000	N/A

## ELECTRICAL

Model	System Circuit Volts			Ph	Frq	Rated Load Amps	Min Cir Amps	Max OCP Amps	Watts	Wires	NEMA Plug	Amps Lights	Amps Fans	Amps Anti-Sweats	Amps Misc/Refrig/Heat
BN37R	Self-Contained (R290)	Circuit #1	208-240	1	60	10.99	15	15	1,812	2+G	6-15P or L6-15P	0.61	0.44	3.44	6.50
	Self-Contained (R290)	Circuit #1	110-120	1	60	15.14	20	20	1,077	2+G	5-20P or L5-20P	1.12	0.90	0.12	13.00
BN47R	Self-Contained (R290)	Circuit #1	208-240	1	60	16.00	20	20	2,824	2+G	6-20P or L6-20P	0.61	0.44	3.50	13.00
	Self-Contained (R290)	Circuit #1	208-240	1	60	16.00	20	20	2,849	2+G	6-20P or L6-20P	0.61	0.44	3.52	13.00

## REFRIGERATION

Model	Zone	Section	System	Env't	REMOTE REFRIGERATION					GLYCOL / R744 REFRIGERATION			
					SST (°F)	Conv. Rack BTUH	Para. Rack BTUH	Defrost Interval (Hrs)	Defrost Duration	Total GPM	Pressure Drop (psi)	Concent (%)	Liquid Temp (°F)
BN37R	All	Refrigerator	Self-Contained-R290	Type II	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
BN47R	All	Refrigerator	Self-Contained-R290	Type II	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
BN57R	All	Refrigerator	Self-Contained-R290	Type II	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

## INTENDED ENVIRONMENT

Type II - Designed to operate in ambient conditions of 80°F and 55% relative humidity unless noted otherwise under Env't above.

## WARMEST AVERAGE PRODUCT TEMP & INTENDED USE OF ZONES

Zone	Temp (°F)	Intended Use
1	40	Packaged refrigerated products

## IMPORTANT NOTES

- 1) Performance issues (product temperatures, water on floor, etc.) caused by adverse conditions are not covered by warranty.
- 2) Levelers must be adjusted during installation to ensure unit is level and plumb.
- 3) Keep unit at least 15' from exterior doors, overhead HVAC vents, or any air curtain disruption.
- 4) Do not expose unit to direct sunlight or any heat source (ovens, fryers, etc.).
- 5) End panels must be tightly joined or kept at least 6" away from any structure to prevent condensation.
- 6) Tile floors, low ceilings, or small rooms will increase noise level.
- 7) Compressor air intake at lower front, discharge from lower rear. Lower panels cannot be blocked. Wall spacers required for proper air flow.
- 8) If GFCI is required, a GFCI breaker MUST be used in lieu of a GFCI receptacle.

## REGULATORY

All Models	<p>Accordance with AHRI Std 1200</p> <p>ETL Listed to UL 471 &amp; UL 60335-2-89</p> <p>ETL Listed to CAN/CSA 22.2 No. 120</p> <p>ETL Sanitation to NSF/ANSI 7</p>
------------	--




In Accordance with  
**AHRI Std 1200**


## Oasis - Refrigerated Self-Service Case 26"D


# Structural Concepts®

DELIVERING FRESH. ALWAYS.™

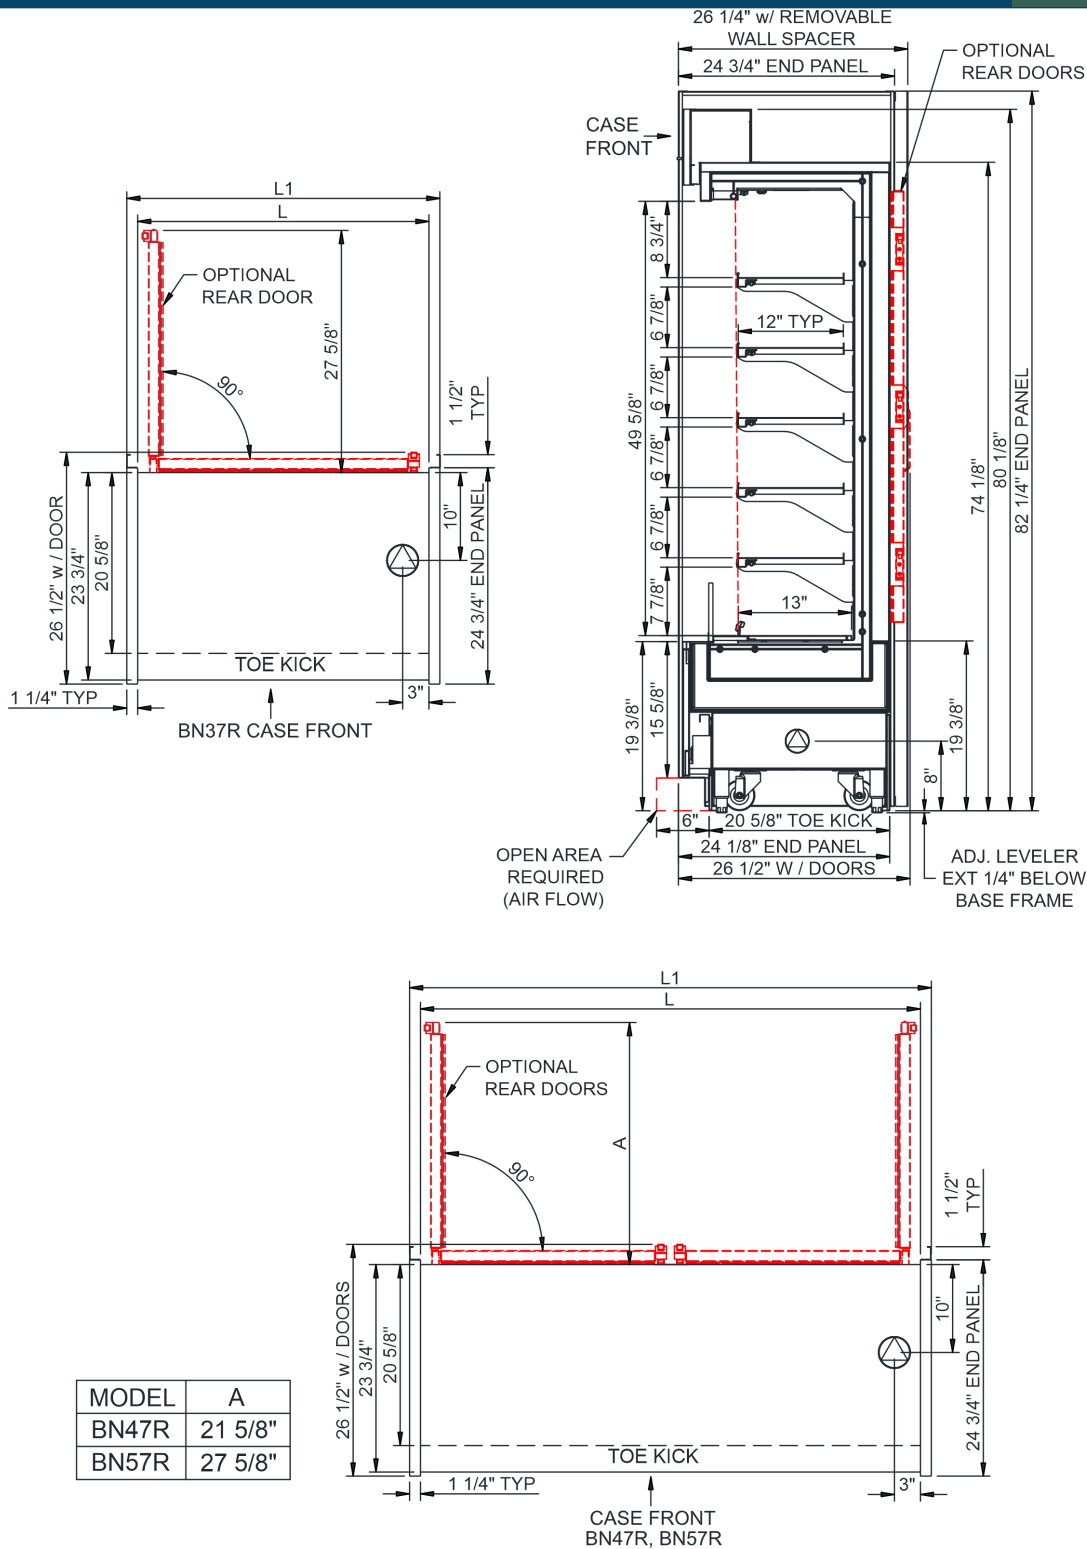

NOTE: ALL DIMENSIONS APPROXIMATE

 **ELECTRICAL JUNCTION BOX**  
(SUPPLIED WITH 6" LEADS OR POWER CORD).

 **LOCATION OF DRAIN TUBE FOR REMOTE REF.**  
**ONLY** (SUPPLIED WITH  $\frac{3}{4}$ " OR  $1\frac{1}{2}$ " PVC TUBE).

 REFRIGERATION LINE CONNECTION.

 REMOTE FLOOR SINK & UTILITIES ACCESS AREA.

 SELF-CONTAINED CASE SERVICE ACCESS AREA.

 DRY CASE SERVICE ACCESS AREA.