

Technical Information

Reveal® - Heated Service Case

Structural Concepts®

DELIVERING FRESH. ALWAYS.™

| DIMENSIONS / SHIPPING | | | | |
|-----------------------|-----|--------|-------|--------------|
| Model | L" | L1" | L2" | Est Wt (lbs) |
| NR3633HSV | N/A | 35.750 | 0.000 | N/A |
| NR4833HSV | N/A | 47.750 | 0.000 | N/A |

| ELECTRICAL | | | | | | | | | | | | | | | |
|------------|----------------------|------------|---------|----|-----|-----------------|--------------|--------------|-------|-------|-----------------|-------------|-----------|------------------|-----------------------|
| Model | System Circuit Volts | | | Ph | Frq | Rated Load Amps | Min Cir Amps | Max OCP Amps | Watts | Wires | NEMA Plug | Amps Lights | Amps Fans | Amps Anti-Sweats | Amps Misc/Refrig/Heat |
| NR3633HSV | Heat (N/A) | Circuit #1 | 208-240 | 1 | 60 | 14.18 | 20 | 20 | 2,788 | 2+G | 6-20P or L6-20P | 0.36 | 0.07 | 13.75 | N/A |
| NR4833HSV | Heat (N/A) | Circuit #1 | 208-240 | 1 | 60 | 19.80 | 30 | 30 | 3,924 | 2+G | 6-30P or L6-30P | 0.36 | 0.07 | 19.37 | N/A |

| REFRIGERATION | | | | | | | | | | | | | | |
|---------------|------|---------|--------|------|----------------------|-----------------|-----------------|------------------------|------------------|-----------------------------|---------------------|-------------|------------------|--|
| Model | Zone | Section | System | Envt | REMOTE REFRIGERATION | | | | | GLYCOL / R744 REFRIGERATION | | | | |
| | | | | | SST (°F) | Conv. Rack BTUH | Para. Rack BTUH | Defrost Interval (Hrs) | Defrost Duration | Total GPM | Pressure Drop (psi) | Concent (%) | Liquid Temp (°F) | |

| INTENDED ENVIRONMENT | | |
|--|-----------|---------------------------------------|
| Type I - Designed to operate in ambient conditions of 75°F with 55% relative humidity unless noted otherwise under Envt above. | | |
| WARMEST AVERAGE PRODUCT TEMP & INTENDED USE OF ZONES | | |
| Zone | Temp (°F) | Intended Use |
| 1 | 160 | Packaged / unpackaged heated products |

| IMPORTANT NOTES |
|---|
| 1) ELECTRICAL NOTE: If GFCI is required, a GFCI breaker MUST be used in lieu of a GFCI receptacle |
| 2) Glass warranty only applicable to first point of delivery. |

| REGULATORY | |
|------------|--|
| All Models | ETL Listed to UL 197 ETL Listed to CAN/CSA 22.2 No. 109 ETL Sanitation to NSF/ANSI 4 |







Technical Information

Reveal® - Heated Service Case

Structural Concepts®

DELIVERING FRESH. ALWAYS.™

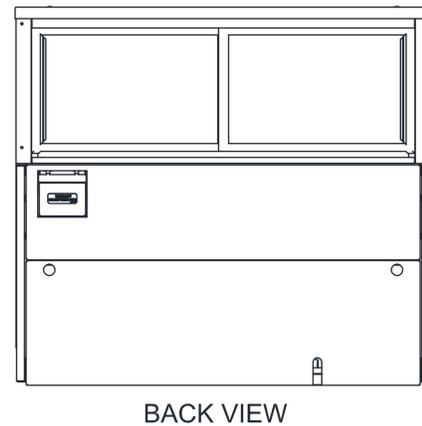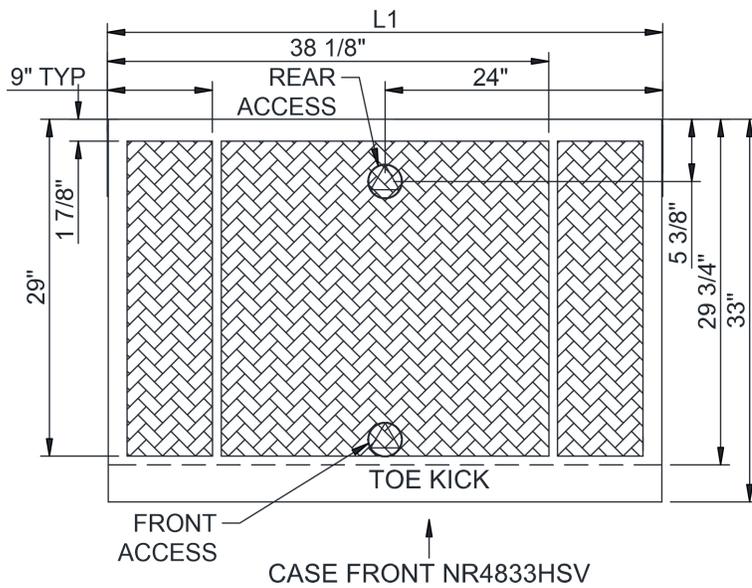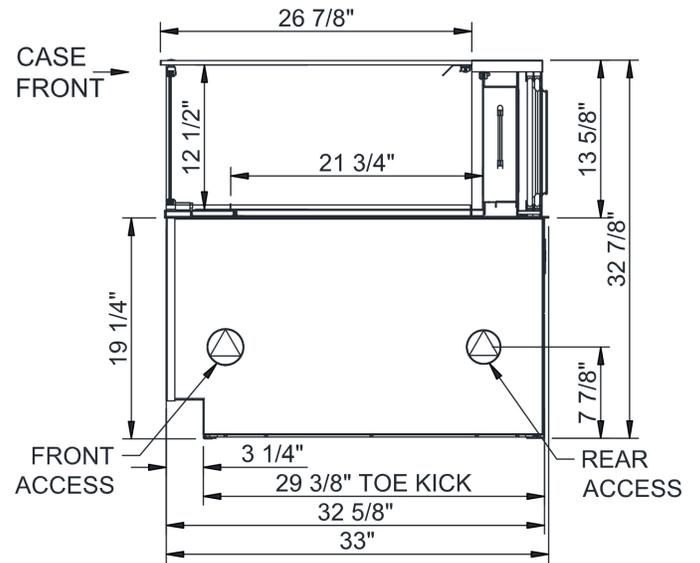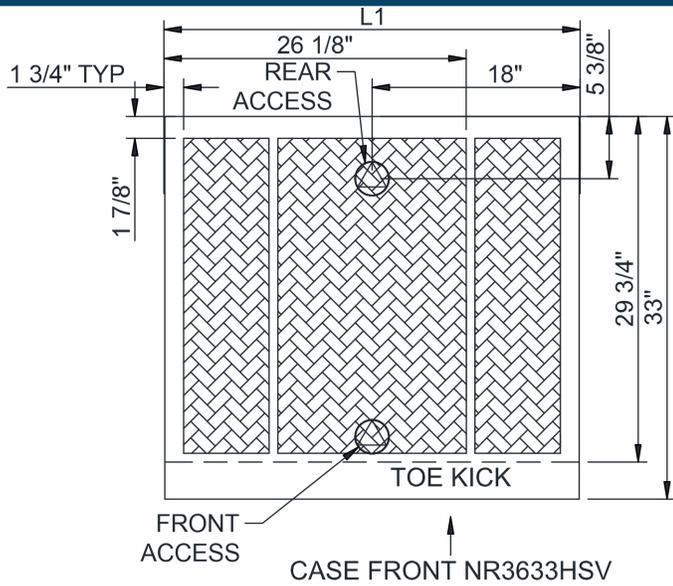

NOTE: ALL DIMENSIONS APPROXIMATE

⊗ ELECTRICAL JUNCTION BOX (SUPPLIED WITH 6" LEADS OR POWER CORD).
 ⊙ LOCATION OF DRAIN TUBE FOR REMOTE REF. ONLY (SUPPLIED WITH 3/4" OR 1 1/2" PVC TUBE).

⊕ REFRIGERATION LINE CONNECTION.
 ☒ REMOTE FLOOR SINK & UTILITIES ACCESS AREA.

▨ SELF-CONTAINED CASE SERVICE ACCESS AREA.
 ☒ DRY CASE SERVICE ACCESS AREA.