

Technical Information

Allure - FLP Straight Open Low Profile Case

Structural Concepts®

DELIVERING FRESH. ALWAYS.™

DIMENSIONS / SHIPPING

Model	L"	L1"	L2"	Est Wt (lbs)
FLP8	96.000	98.250	48.000	N/A
FLP9	108.000	110.250	54.000	N/A

ELECTRICAL

Model	System Circuit Volts			Ph	Frq	Rated Load Amps	Min Cir Amps	Max OCP Amps	Watts	Wires	NEMA Plug	Amps Lights	Amps Fans	Amps Anti-Sweats	Amps Misc/Refrig/ Heat
FLP8	Remote (GLYCOL)	Circuit #1	110-120	1	60	1.06	15	15	104	2+G	Leads Single		0.70	0.36	N/A
	Remote (DX)	Circuit #1	110-120	1	60	1.06	15	15	104	2+G	Leads Multiple		0.70	0.36	N/A
	Remote (R744 T)	Circuit #1	110-120	1	60	1.06	15	15	104	2+G	Leads Single		0.70	0.36	N/A
FLP9	Remote (DX)	Circuit #1	110-120	1	60	1.10	15	15	108	2+G	Leads Single		0.70	0.40	N/A
	Remote (GLYCOL)	Circuit #1	110-120	1	60	1.10	15	15	108	2+G	Leads Single		0.70	0.40	N/A
	Remote (R744 L)	Circuit #1	110-120	1	60	1.18	15	15	118	2+G	Leads Single		0.70	0.40	0.08

REFRIGERATION

Model	Zone	Section	System	Env't	REMOTE REFRIGERATION					GLYCOL / R744 REFRIGERATION			
					SST (°F)	Conv. Rack BTUH	Para. Rack BTUH	Defrost Interval (Hrs)	Defrost Duration	Total GPM	Pressure Drop (psi)	Concent (%)	Liquid Temp (°F)
FLP8	All	Main	Remote-Glycol	Type I	N/A	5,357	4,960	4.00	45.00	0.95	3.50	35%	26.00
	All	Main	Remote-DX	Type I	26	5,357	4,960	4.00	25.00	N/A	N/A	N/A	N/A
	All	Refrigerator	Remote-R744 TRANSCRITICAL	Type I	26	5,357	4,960	4.00	25.00	N/A	N/A	N/A	N/A
FLP9	All	Main	Remote-DX	Type I	26	6,480	6,000	4.00	25.00	N/A	N/A	N/A	N/A
	All	Main	Remote-Glycol	Type I	N/A	6,480	6,000	4.00	45.00	2.00	6.80	35%	26.00
	All	Main	Remote-R744 LIQ OVERFEED	Type I		6,480	6,000	4.00	30.00	0.40	0.42	N/A	26.00

INTENDED ENVIRONMENT

Type I - Designed to operate in ambient conditions of 75°F with 55% relative humidity unless noted otherwise under Env't above.

WARMEST AVERAGE PRODUCT TEMP & INTENDED USE OF ZONES

Zone	Temp (°F)	Intended Use
1	40	Floral products

IMPORTANT NOTES

- 1) ELECTRICAL NOTE: If GFCI is required, a GFCI breaker MUST be used in lieu of a GFCI receptacle.
- 2) Units must be shimmed during installation to ensure the unit is level and plumb.
- 3) Keep unit at least 15' from exterior doors, 10' from overhead HVAC vents, 5' from exterior windows.
- 4) Performance issues (product temperatures, water on floor, etc) caused by adverse conditions are not covered by warranty.

REGULATORY

All Models	Accordance with AHRI Std 1200 ETL Listed to UL 471 ETL Listed to CAN/CSA 22.2 No. 120
------------	---






In Accordance with
AHRI Std 1200

Technical Information

Allure - FLP Straight Open Low Profile Case

Structural Concepts®

DELIVERING FRESH. ALWAYS.™

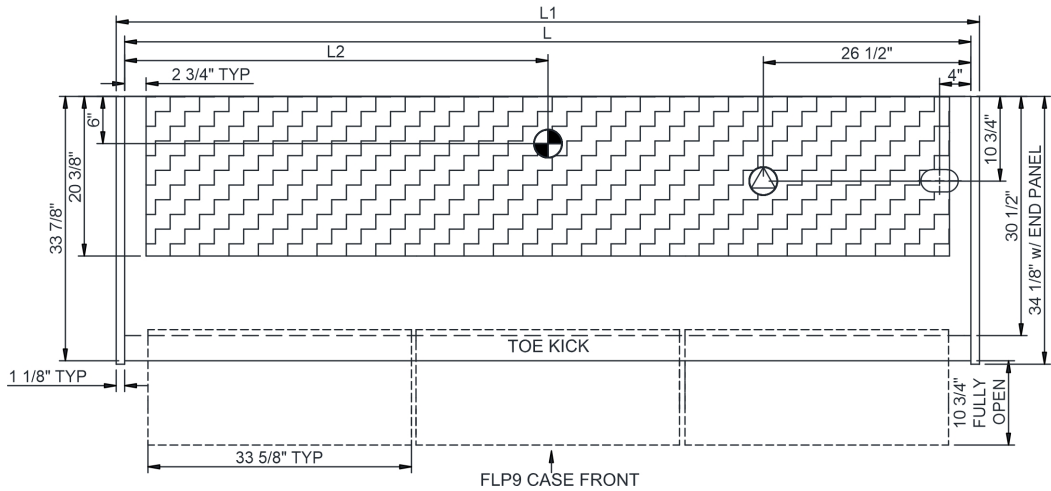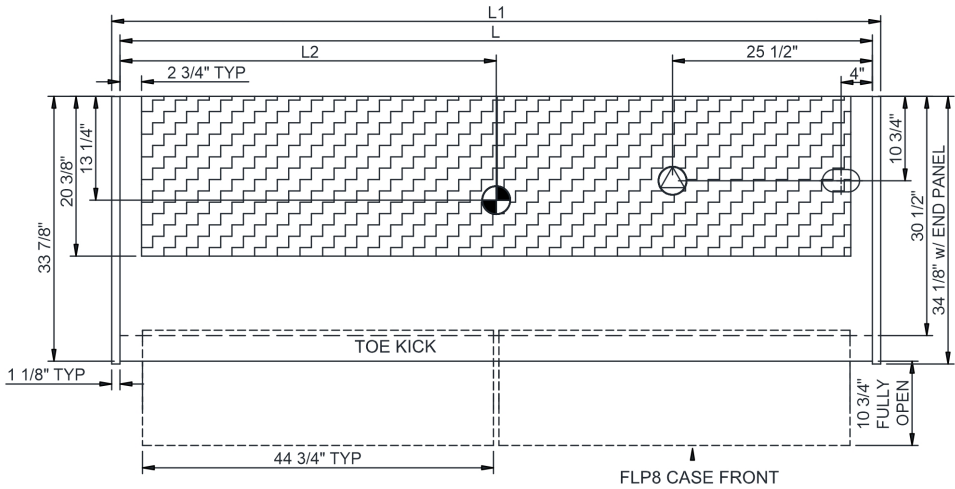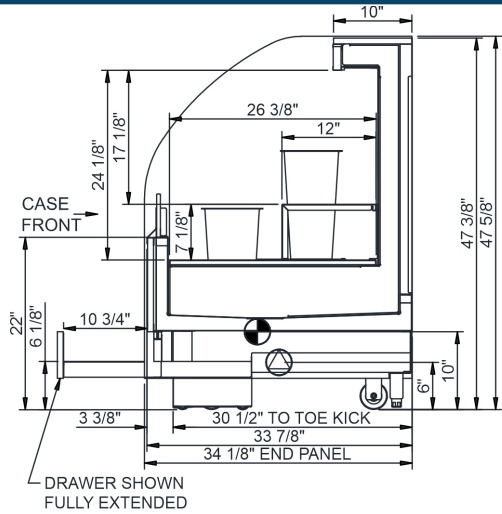

NOTE: ALL DIMENSIONS APPROXIMATE

- ELECTRICAL JUNCTION BOX (SUPPLIED WITH 6" LEADS OR POWER CORD).
- REMOTE FLOOR SINK & UTILITIES ACCESS AREA.

- REFRIGERATION LINE CONNECTION.
- SELF-CONTAINED CASE SERVICE ACCESS AREA.

- DRY CASE SERVICE ACCESS AREA.